

# Instructions for Preparing AFL OPTICAL GROUND WIRE CABLE IN THE OPTI-GUARD™ SPLICE ENCLOSURE (HEXACORE CABLE DESIGNS)

## **NOTE:**

EXCEPT AS MAY BE OTHERWISE PROVIDED BY CONTRACT, THESE DRAWINGS AND/OR SPECIFICATIONS ARE THE PROPERTY OF AFL TELECOMMUNICATIONS, ARE ISSUED IN STRICT CONFIDENCE, AND SHALL NOT BE REPRODUCED OR COPIED OR USED AS THE BASIS FOR MANUFACTURE OR SALE OF PRODUCT WITHOUT PERMISSION.

CERTAIN INFORMATION SUCH AS THE DATA, OPINIONS OR RECOMMENDATIONS SET FORTH HEREIN OR GIVEN BY AFL REPRESENTATIVES, IS INTENDED AS A GENERAL GUIDE ONLY. EACH INSTALLATION OF OVERHEAD ELECTRICAL CONDUCTOR, UNDERGROUND ELECTRICAL CONDUCTOR, AND/OR CONDUCTOR ACCESSORIES INVOLVES SPECIAL CONDITIONS CREATING PROBLEMS THAT REQUIRE INDIVIDUAL SOLUTIONS AND, THEREFORE, THE RECIPIENT OF THIS INFORMATION HAS THE SOLE RESPONSIBILITY IN CONNECTION WITH THE USE OF THE INFORMATION. AFL DOES NOT ASSUME ANY LIABILITY IN CONNECTION WITH SUCH INFORMATION.

---


## **TABLE OF CONTENTS**

<b>CONTENTS</b>	<b>PAGE NO.</b>
List of Materials	3
OPTI-GUARD Splice Enclosure Assembly Diagram	4
Connector Assembly Diagram	5
Splice Tray Assembly Diagram	6
Purpose of Installation	7
Scope	7
Precautions	7
Cable Preparation at Towers	7
Removal of Outer/Inner Strands	8
Connector Kit Installation	8
Removal of Stainless Steel Tubes	11
Separation of String Binders / Cleaning Optical Units	12
Placement of Optical Fibers in Transition Tubing / Trays	14
Addendum A: Tube Straightener	16
Addendum B: High Capacity Splice Tray	16


## List of Materials

ITEM	DESCRIPTION	QTY
1	Splice Enclosure Assembly (consisting of the Casing, Drawer and related parts)	
	Casing (NOTE: Parts listed below are factory assembled on casing):	
	Upper Mounting Plate	1
	Lower Mounting Plate	1
	Flat Socket Head Cap Screw	8
	Pressurizing Valve	1
	Drawer (NOTE: Parts listed below are factory assembled on drawer):	
	Adhesive Backed Gasket	1
	Tie Wrap Retainer	1
	(NOTE: Parts listed below are removable from drawer):	
	Expansion Plugs	6
	Strength Member Termination Bars	2
	Eye Bolt (part of Termination Bar)	6
	Lock Nut (part of Termination Bar)	6
	Carriage Bolt (for Splice Tray retaining)	1
	Extension Nut (for Splice Tray retaining)	1
Hex. Head Bolt (flange hardware)	8	
Lock Washer (flange hardware)	8	
Flat Washer (flange hardware)	8	
Humi-Sorb Bag	1	
2	Connector Assemblies (the following comprise one connector):	
	Connector Body	1
	Retainer Nut	1
	Entry Bushing	1
	O-Ring	1
	Retaining Cap	1
	Range-Taking Flanged Sleeve	1
	Wire Retainer	1
Set Screws	2	
3	Splice Tray Assembly	
	Tray	1
	Cover	1
	Manifold	2
4	Splice Protector Sleeves	Order separately based on actual fiber count
5	Furcation Kit (AFL Part No. OGFK01) includes:	
		1 Per SS Fiber Tube
	Fiber Protection Tubing	
	Heat Shrink Tubing	
	Primary Transition Tubing	
	Secondary Transition Tubing	
	Labels	
Cushion Tape		
Tie Wraps		
6	Stainless Steel Tubing Cutter (AFL Part No. SSCUTTER)	1
7	Small Hose Clamps	2
8	D-Gel or Other Approved Gel Remover	1
9	Small Circular Pan (e.g. 8" cake pan)	2
10	RTV-108 Adhesive	1
11	Stainless Steel Tube Straightener (Optional – available from AFL)	1


## Opti-Guard™ Splice Enclosure Assembly

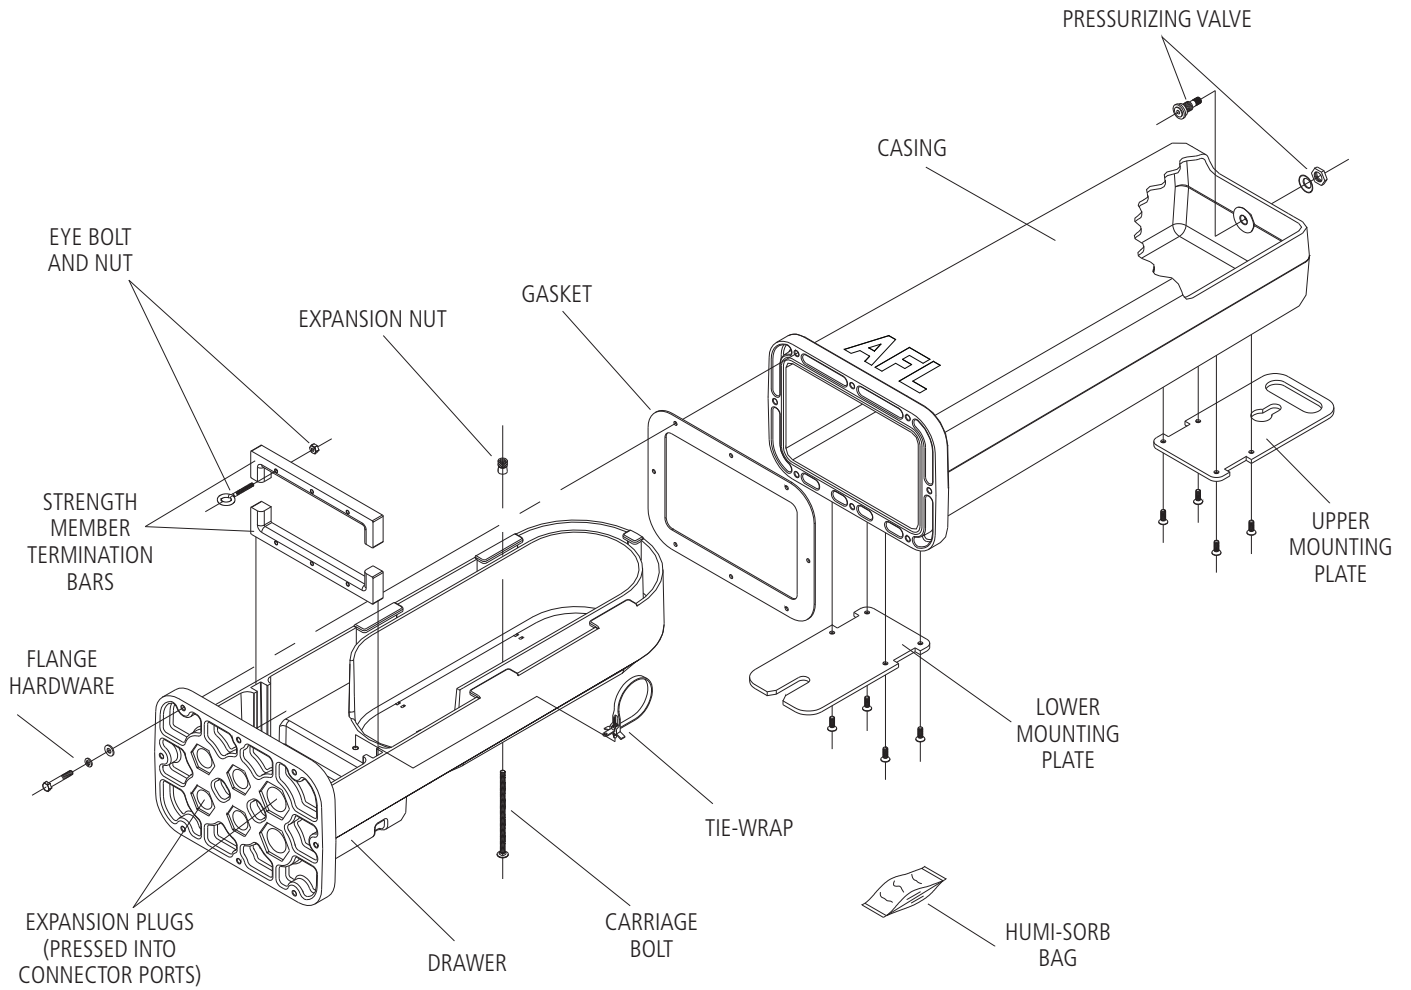

**Connector Assembly**

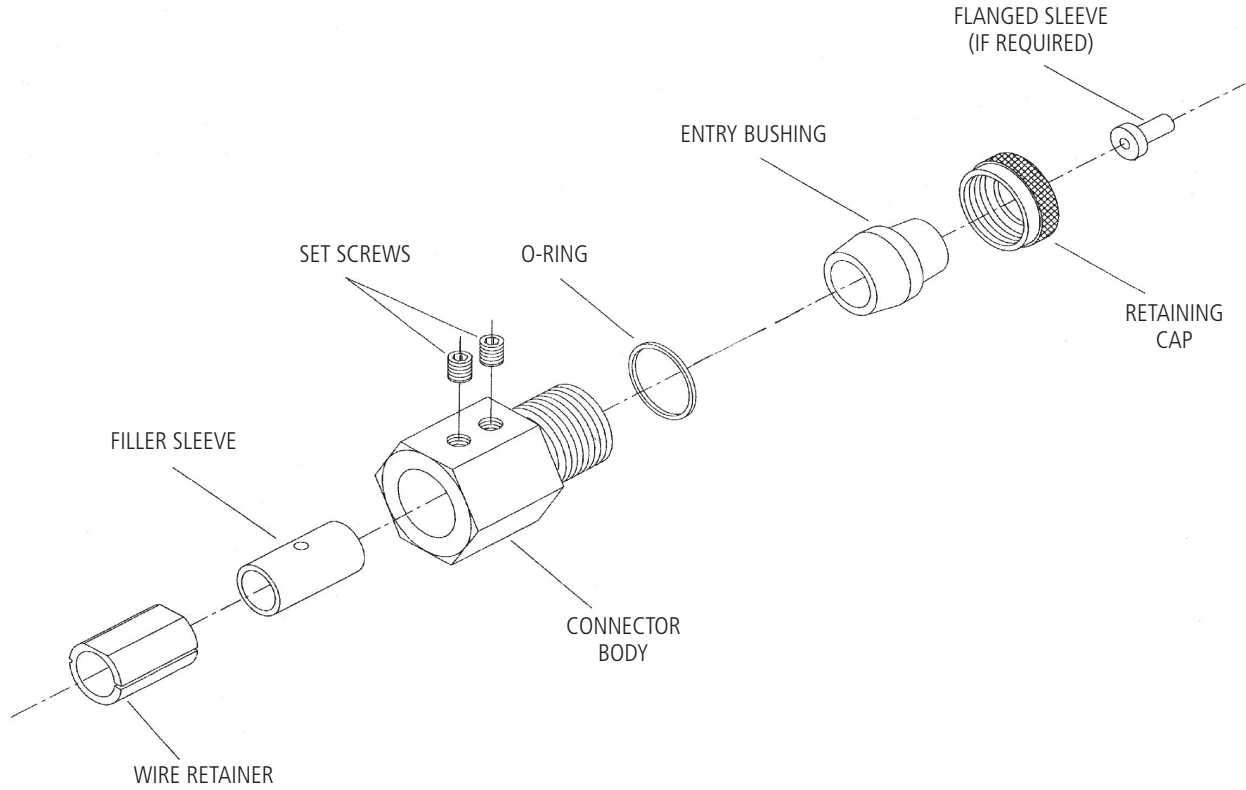

## Splice Tray Assembly

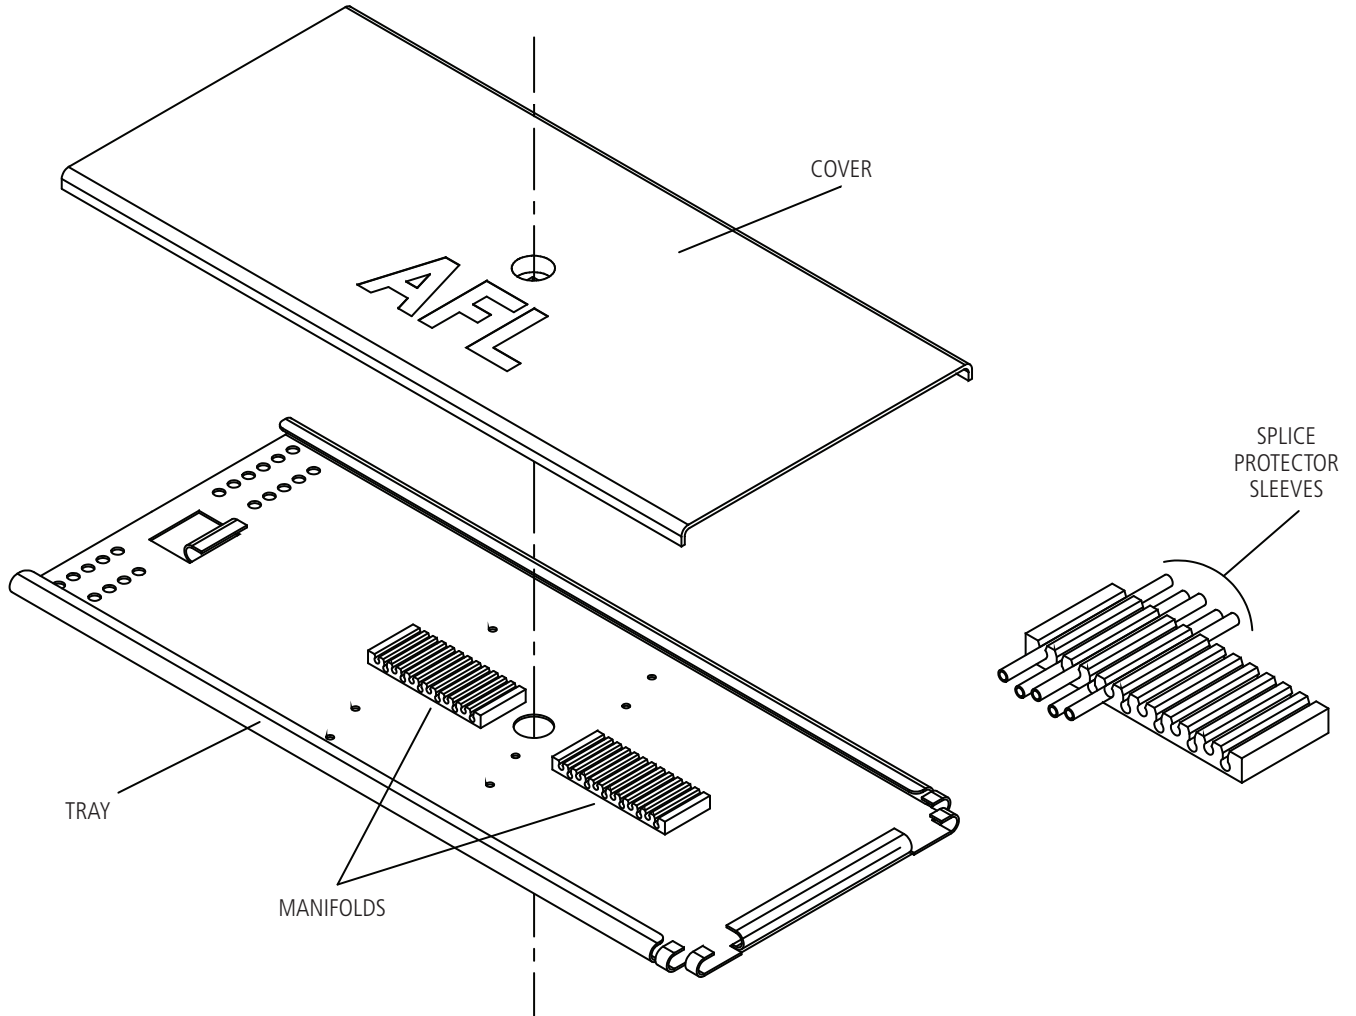

## 1.0 Purpose of Installation

The purpose of installing optical cables into a splice enclosure is to connect the individual fibers of the cables providing a continuous light path while protecting the connection in a sealed enclosure.

## 2.0 Scope

This document describes and illustrates the installation of Optical Ground Wire into the AFL OPTI-GUARD Splice Enclosure. This enclosure has the following advantages:

1. Light weight;
2. No sealers or tapes required;
3. Maintenance friendly (no re-entry kits required);
4. Standard capacity of up to 360 single-fusion fiber splices;
5. Accepts various splice tray types; and
6. Accepts up to 6 cables.

## 3.0 Precautions

### 3.1 Health

Optical fibers are very thin, fragile and sharp. Therefore, careful handling is required to avoid either damage to the delicate glass fibers, or more importantly, injury to the technician or bystander. Small fiber scraps should be deposited on strips of adhesive tape, placed in a bottle or vinyl bag and properly disposed. Do not eat or drink when working with optical fibers as small pieces of glass may inadvertently be ingested. Never look directly at the end of a fiber unless certain that no laser light is being transmitted through the fiber.

### 3.2 Work Environment

Handle optical fiber and cable carefully, taking care to impose no damage by physical shock or sharp bends. During the actual splicing, care must be taken to keep hands and work area clean in order that the fibers may be kept clean. Keep all tools and equipment in their proper cases or storage pouches when not in use. Consideration should be given to the work area in which the enclosure will be organized. A clean, snag-free horizontal surface protected from the wind is necessary.

## 4.0 Cable Preparation at Towers

- 4.1 The OPTI-GUARD splice enclosure is designed to allow the splice drawer to be removed and lowered to the ground while leaving the casing intact on the structure. The first step is to determine the amount of cable needed to take advantage of this feature. This amount of cable includes the distance from the splice enclosure mounting position on the tower to the ground plus any additional length desired to transport the splice drawer to a suitable workstation once on the ground. AFL recommends that this extra length of cable be stored using a large drip loop(s) prior to entering the enclosure. NOTE: The diameter of this drip loop(s) must be a minimum of 40 inches, regardless of the diameter of the cable. **IMPORTANT:** The coil of cable must be stored on structure prior to preparing the enclosure. Only uncoil the amount of cable used for preparation of the enclosure.
- 4.2 Once the extra length of cable, discussed in Section 5.1, has been determined, mark each cable using electrical tape at the point where the cables will enter the enclosure. This will be referred to as Mark "A".
- 4.3 From the free end of the cable, cut back in 2-foot increments until the optical fibers are located.
- 4.4 From Mark "A", measure 14 feet toward the free end and cut the cable at this point. This length allows for furcation of the tubes (see Section 10.0 for explanation of furcation) and 6 feet of fiber in the splice trays.

- 4.5 Place a hose clamp or electrical tape around the cable approximately 2 feet behind Mark "A" (see Fig. 1). This secures the outer strands from unlaying during subsequent handling of the cable. Secure both cables to a workbench or table so that they are held rigidly in place (see Fig. 2). The use of a tower guide clamp attached to a workbench is an adequate means of stabilizing the cable.

**Fig. 1**



**Fig. 2**



## 5.0 Removal of Outer/Inner Strands

- 5.1 Unlay the outer strands from the free end back to Mark "A" and cut (see Figs. 3 and 4). Be careful not to nick, cut or pry against the stainless steel tubes when unlaying and cutting the outer strands. After all outer wires have been cut at Mark "A", fan the remaining length of outer wires back to the hose clamp or electrical tape located 2 feet behind "Mark A." This will allow access to the inner layer of strands and stainless steel tubes. Approximately 10 inches back from Mark "A", wrap electrical tape around the inner layer of strands. Replace outer strands to their original lay around the inner strands.

**Fig. 3**




**Fig. 4**



## 6.0 Connector Kit Installation


- 6.1 Measuring from the ends of the outer strands toward the free end, mark the inner wires at  $\frac{3}{4}$  inch, then mark each of the stainless steel tubes at 7 inches. Carefully unlay the stainless steel tubes of the inner layer, and then unlay the remaining strands. Cut the center strand 12 inches from the end of the outer strands. Cut the remaining inner layer wires at the  $\frac{3}{4}$  inch mark (see Fig. 5). If using an AFL tube straightener, refer to Appendix A.

**Fig. 5**

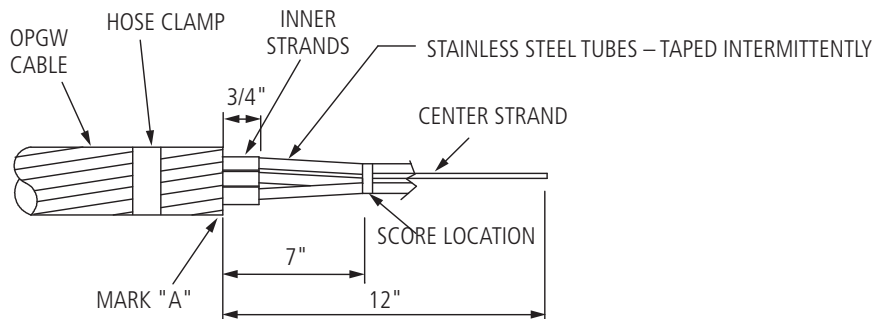


- 6.2** This step involves scoring the stainless steel tube(s). Practice scoring, flexing, and breaking the stainless steel tube on a scrap piece of cable. Practicing this procedure helps ensure that the optical fibers are not damaged during tube removal. When comfortable with the process, score the stainless steel tube(s) at the 7-inch mark (see Fig. 6). **DO NOT BREAK OR REMOVE THE TUBES AT THIS POINT!** (The tubes will be removed after insertion into the enclosure). Tape the stainless steel tubes together intermittently for ease of insertion into the connector body and enclosure.

**Fig. 6**

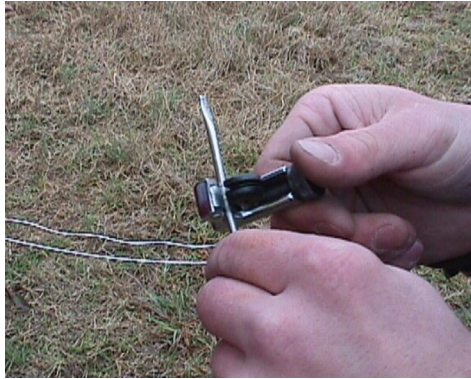


- 6.3** Slide the proper size wire retainer over the outer strands. Position flush with the cut ends of the outer layer (see Fig. 7).

**Fig. 7**

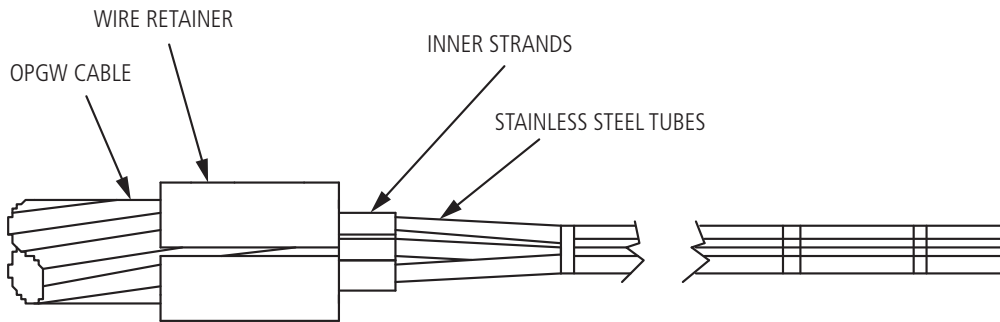


- 6.4** Place a bead of silicone on the outer layer wire tips and around the inner strands to fill all voids. Slide the filler sleeve over the stainless steel tubes and inner strands. While holding sleeve in place, insert silicone into the filler sleeve hole until silicone comes out of the end of the sleeve (see Fig. 8). Rotate the sleeve 180° and again insert silicone until it extrudes out end of sleeve — this will ensure more complete filling of the space within the sleeve.

**Fig. 8**

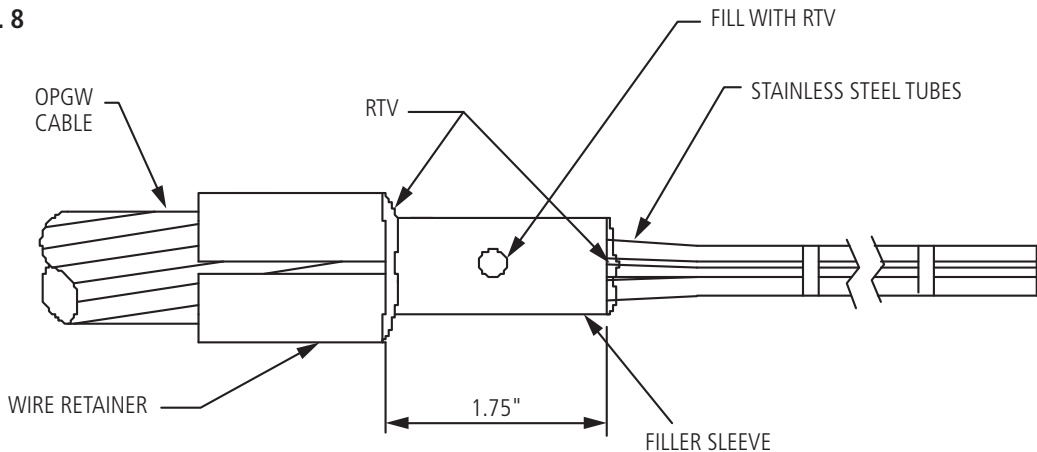


- 6.5 Slide the stainless steel tubes through the connector body until the wire retainer is seated. The flat surface of the wire retainer should be perpendicular to the setscrews before tightening the wire retainer.
- 6.6 Tighten the setscrews, to lock the wire retainer and cable into position. The edge of the wire retainer should fit flush with the edge of the connector.
- 6.7 Slide the bushing (note orientation as illustrated) over the stainless steel tubes. Push the bushing in the connector body. Make sure that the bushing is seated in the connector body. (See Fig. 9)

**Fig. 9**


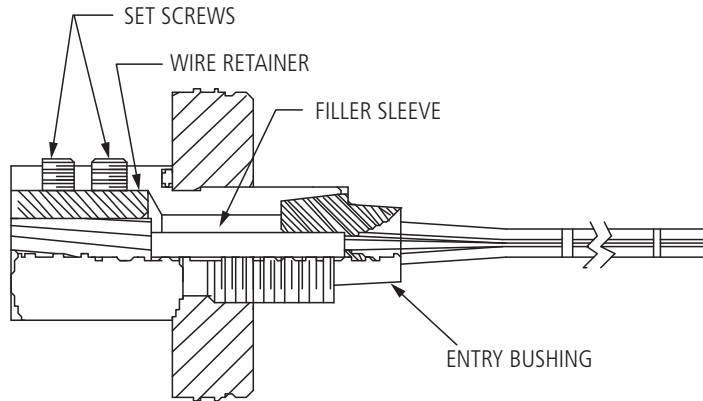


- 6.8 Locate the cable port into which the cable is to be installed. Remove the appropriate port plug by knocking the plug out of the splice enclosure drawer from the inside outward using a hammer, punch, or screwdriver. An alternative method for removing the plug is to drill a ¼" hole in the approximate center of the plug, then use the tip of a screwdriver to "lever-out" the plug. Take care not to damage the cable port during plug removal—particularly the outer surface, since the connector's O-ring will seal against the bottom of the port hex. NOTE: Do not remove a plug unless a connector will be installed in that port!
- 6.9 Slide the stainless steel tube(s) and connector body through the selected port. Position the connector body in the port — making certain that the O-ring is clean and is properly in position and that the set screws will be accessible for tightening.
- 6.10 Slide the hex nut and seal cap over the tube(s).
- 6.11 Tighten the hex nut onto the connector body, against the inside of the drawer. The body of the connector should "socket-fit" into the hex face of the enclosure port.
- 6.12 Tighten the retaining nut over the silicone bushing (see Fig. 10).

**Fig. 10**

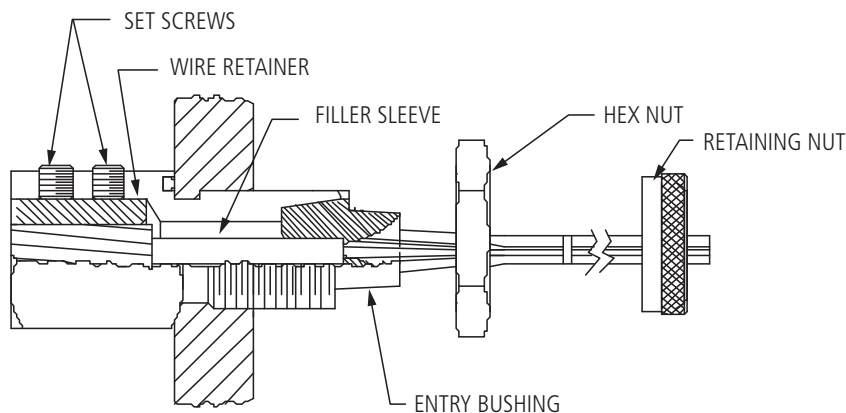


- 6.13** Feed the center strand through the hole directly in front of the port on the termination bar. It may be necessary to loosen the connector body from the port and slide the cable back to allow the center strand to be threaded through the termination bar. Re-tighten the lock nut against the inside of the drawer and the seal cap to hold the entry bushing in place. Place the range-taking flanged sleeve on the center strand (see Fig. 11). The center strand shall extend to the farthest possible end of the applicable flanged sleeve range section (see Fig. 11.1). Apply the maximum tension to the center strand and compress the flanged sleeve tightly over the center strand with a standard crimping tool. Trim any excess center strand if it has been allowed to pass completely through the range-taking flanged sleeve.

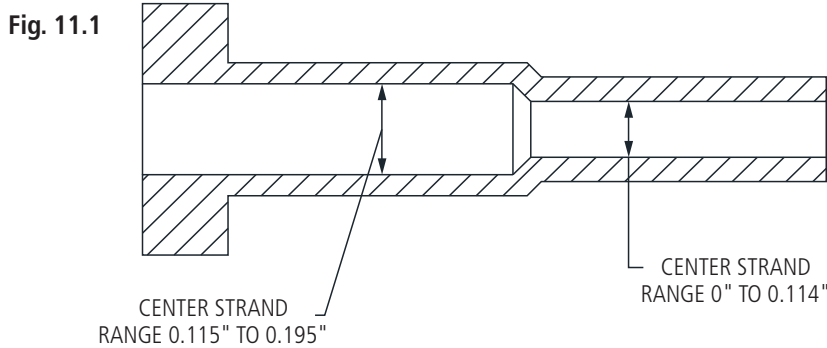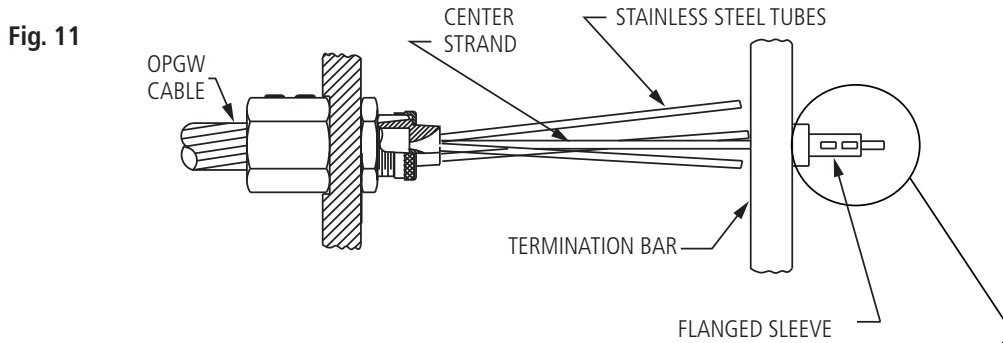

## 7.0 Removal of Stainless Steel Tubes

**NOTE:** Certain required components listed in these instructions, such as tubing and labels, are available and sold separately. Order AFL part number OGFK01 Furcation Kit.

- 7.1** From the scored location on the stainless steel tube(s), mark each tube at 4-foot increments. Be careful to label each tube with some form of identification (i.e., wire markers, colored pen marks, etc. — see Fig. 12).

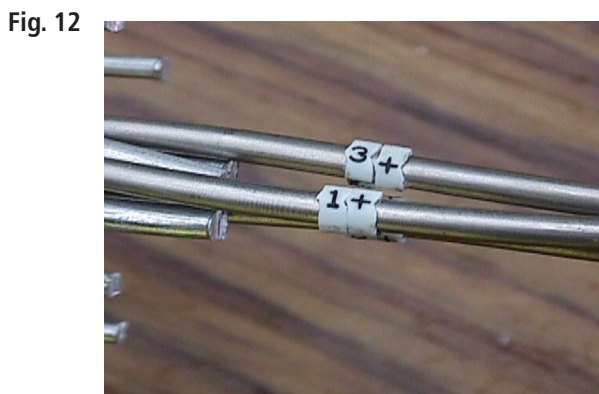

- 7.2 Choose a stainless steel tube and carefully score it at the mark closest to the free end. Flex the tube at the scored location in order to break and separate the tube. Continue to score and remove each 4-foot piece of tube until the tube is removed. **NOTE:** Special care should be taken to ensure that the fibers do not scrape against the ends of the tubes during removal.
- 7.3 It is optional at this point to lightly wipe the excess gel from the fibers. It is crucial that the colored thread binders not be disturbed as to maintain each bundle identity for later separation.
- 7.4 Cut a 2" length of the heat shrink tubing for each stainless steel tube. Slide the heat shrink tubing over the fibers and 1" over the stainless steel tube.
- 7.5 Using a heat gun, shrink the tubing around the stainless steel tube and fibers. Special care should be taken to ensure that the hot air blast does not remain on the optical fibers for an extended period. Allow the tubing to cool for approximately 10 minutes.

## 8.0 Separation of String Binders/Cleaning Optical Units

- 8.1 Starting at the end closest to the stainless steel tube, separate the fibers until you identify one of the colored string binders (See Fig. 13).  
**NOTE:** AFL's optical ground wires use two colored thread binders to identify each group of twelve fibers in a buffer tube. This built-in redundancy makes for a fail-safe method to identify fiber groups in the unlikely event that any binders should break.
- 8.2 Lightly pull on the binder until the bundle starts to separate from the other fibers.
- 8.3 Once a single bundle has been identified, inspect the bundle for the matching color prior to separating the fibers from the other bundles. Once you have identified that both binders are around the same fiber group, separate the unit from the other fibers (see Fig. 14).

Fig. 13

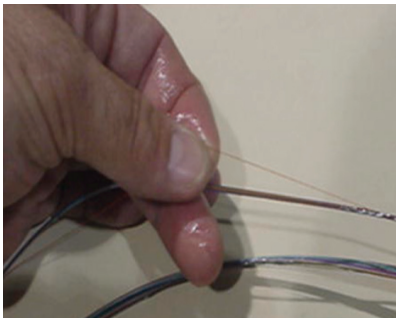


Fig. 14




- 8.4 Repeat steps 8.2 through 8.3 on each of the fiber bundles. Separate each group of bundled fibers to ensure easy identification (see Fig. 15).
- 8.5 On each of the fiber bundles, confirm that the fibers meet the proper color code and specified fiber amount (see Fig. 16).


Fig. 15




Fig. 16

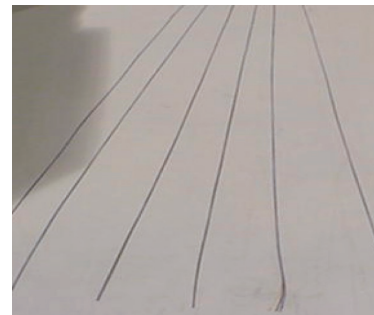

- 8.6 After all of the fiber bundles have been checked, return to the fiber end closest to the buffer tube. Separate and cut both string binders approximately 12 inches from the buffer tube. Remove and dispose of the excess binder from the optical fibers (See Fig. 17). Take both remaining binders and loosely loop it through itself to form a small slipknot around the bundle they mark. Repeat this process 4 to 5 times. Cut the excess binder, approximately 1.5 inches above the knot (see Fig. 18).

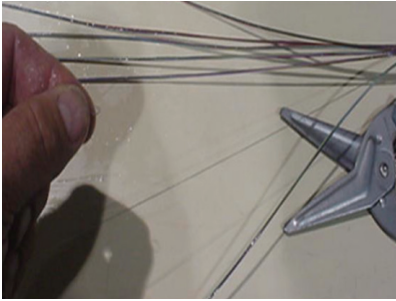**Fig. 17****Fig. 18**

- 8.7 Ensure that each bundle is identifiable before continuing on to the next.
- 8.8 After all fiber bundles have been identified, clean each individual fiber group with a standard gel removal cleaner (see Figs. 19 and 20).

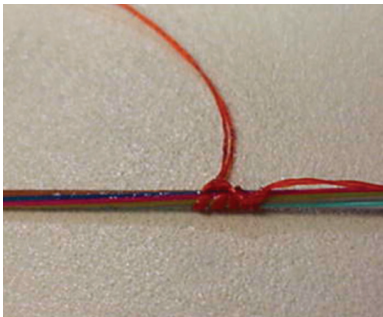**Fig. 19****Fig. 20**


- 8.9 Repeat sections 7.0 and 8.0 for each stainless steel buffer tube.

## 9.0 Placement of Optical Fibers in Transition Tubing / Trays

**NOTE:** If planning to use the AFL 48 Fiber Splice Tray, refer to Addendum B in lieu of Steps 9.1 and 9.2.

- 9.1** In order to protect the fiber as it is routed from the end of the stainless steel tube to a splice or transition tray, measure and cut a piece of primary transition tubing long enough to reach from the end of the stainless steel tube to the tray. Slide this primary transition tubing over the fibers, fitting it snugly around the heat shrink tubing at the mouth of the stainless steel tube. Route the primary transition tubing to a splice/transition tray and secure the tubing to the tray. In the case of two high fiber count optical ground wire cables being spliced together as shown in Fig. 21, it is advisable to use the same transition tray for the two stainless steel tubes being spliced. Ensure that all tubing is clearly marked for ease of identification.

**Fig. 21**

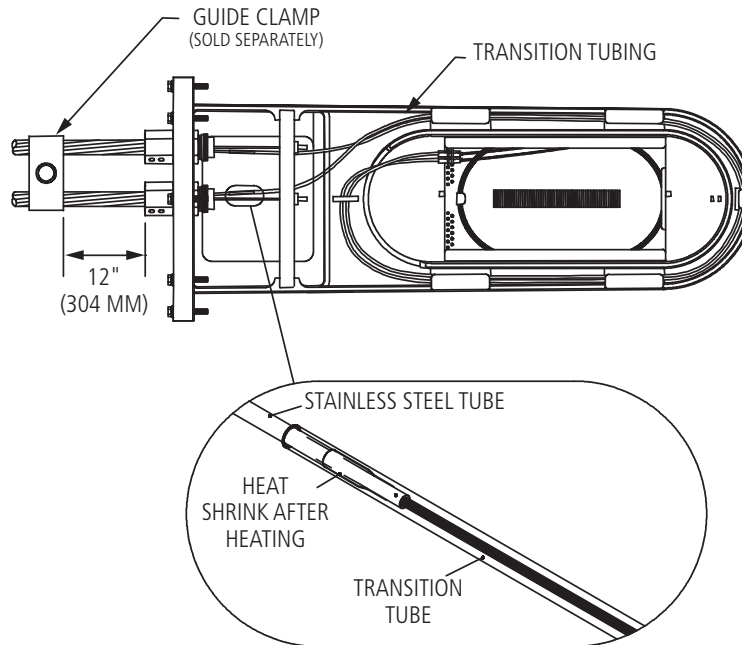


- 9.2** If furcation (subdividing a large group of fibers into smaller groups) is required, use the transition tray to segregate the fibers into smaller bundles (see Fig. 21). A length of secondary transition tubing sufficient to route the fiber from the transition tray, around the enclosure drawer raceway, and into the actual splice tray will be needed for each sub-group of fibers. Slide the secondary transition tubing over the sub-group of fibers. Secure the end of the tubing to the transition tray.
- 9.3** Once the fibers have been spliced, protected, and positioned, replace the lid on the tray. Ensure that no fibers are protruding from the tray and in danger of being damaged when the lid is replaced. Wrap the transition tubing around the drawer raceway in a clockwise direction and position the tray onto the mounting bolt. Repeat until all trays are in place. Place the tension nut on the bolt and tighten until snug. Use the tie-wrap to secure the transition tubing.
- 9.4** The drawer assembly is now complete and ready to install into the casing. Torque the bolts to 35 in-lbs. This will cause a visual protrusion of the gasket approximately 1/64" to 1/32" from its original position. A pressure valve has been provided to purge the enclosure of moisture (if required) and to pressurize the seal to 10 psi maximum.

**IMPORTANT:** Attach a guide clamp (sold separately) to each pair of cables approx. 12 inch (304 mm) from the bottom of the connector assembly before transporting the prepared enclosure. This will help prevent the cables from twisting inside the enclosure while transporting (see Fig. 21 of previous page).

9.5 Secure the loose cable to the structure to complete installation. See Fig. 22 below for typical installations.

Fig. 22

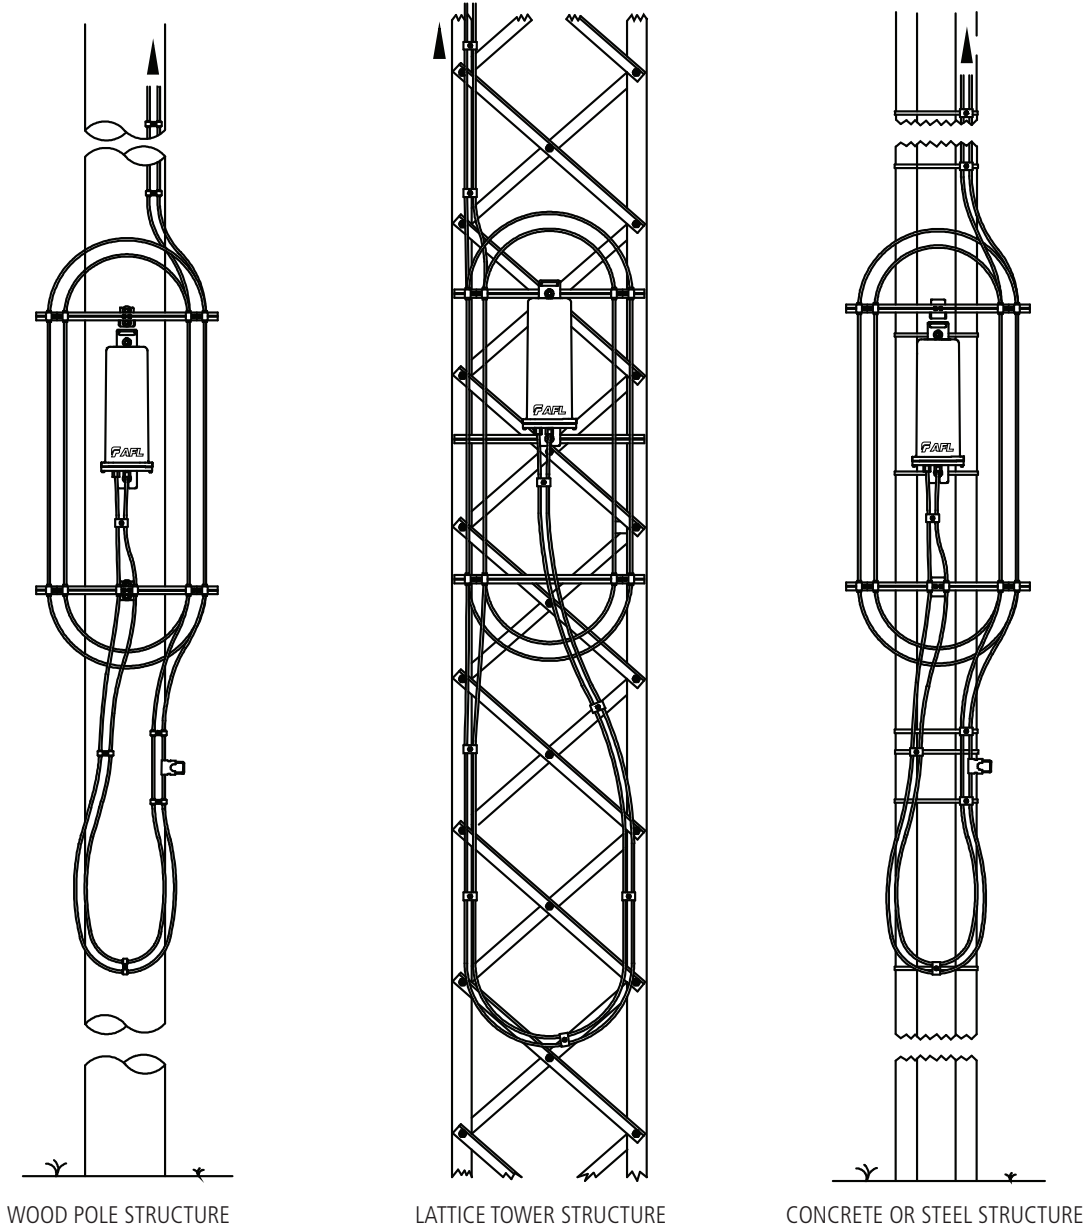

## Addendum A

If using an AFL tube straightener, loosen the rollers to allow the stainless steel tube to pass through easily. Insert the free end of one tube into one end of the tool, between the rollers, and out the other end. Slide the tool along the stainless steel tube back to the 8-inch mark. Tighten the rollers together until all are contacting the tube. The purpose is to tighten the rollers to the point where they straighten the tube when it is pulled through them. You may want to practice this procedure on a scrap length of tubing to get an idea of how tight the rollers should be. Over-tightening may crush the tubes and/or damage the fibers. Once the rollers are tightened, use the handles on both sides of the tool to slide it toward the free end, thereby straightening the tubes for ease of tube removal. Refer to Fig. 23.

**Fig. 23**




## Addendum B

For some applications, it may be preferable to utilize the AFL OGBT-01 (high capacity splice tray) to avoid the process of fiber furcation as described in section 8 of this document. For splicing cables with ultra high fiber counts (>144 fibers), the high capacity splice tray is required to maximize splicing space within the OPTI-GUARD Splice Enclosure. This addendum is intended for use once all steps through Section 8.0 have been completed.


- B.1** In order to protect the fiber as it is routed from the end of the stainless steel tube to the splice tray, use a piece of the clear primary transition tubing supplied with the tray. Slide the primary transition tubing over the fibers, fitting it snugly around the heat shrink tubing at the mouth of the stainless steel tube. Route the primary transition tubing around the raceway once and into the splice tray, securing the tubing to the tray. This loop of tubing around the raceway will allow the splice tray to be removed from the drawer. Ensure that all tubing is clearly marked for ease of identification.

**Fig. 21**

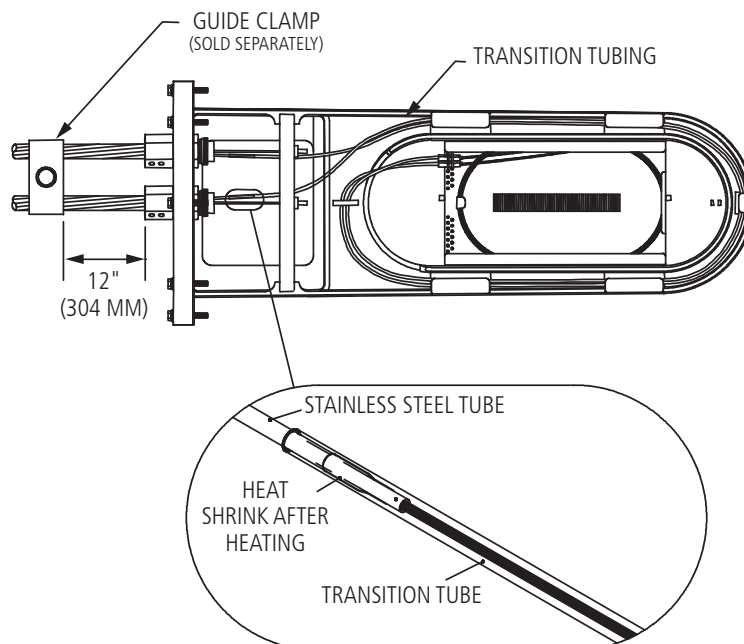

- B.2** Proceed with splicing the fibers and mounting the fusion protection sleeves into the rigid manifolds supplied with the tray. To accommodate 48 fibers, the manifolds can be mounted in a single file line down the middle of the tray, allowing room for the excess fiber to route around the perimeter of the tray.
- B.3** Once the fibers have been spliced, protected, and positioned, replace the lid on the tray. Ensure that no fibers are protruding from the tray and in danger of being damaged when the lid is replaced.
- B.4** Once the splicing is complete and the trays are ready to be mounted into the drawer, position the two bolts (5" in length) up through the bottom of the drawer in the holes as shown below. Two black, flat speed nuts are provided with the box. Use a nut, concave side facing downward, to secure each bolt to the drawer. Lower the trays between the bolts. Once all trays are in the drawer, place the black strap across the trays and press down onto the bolts.

**Fig. 22**

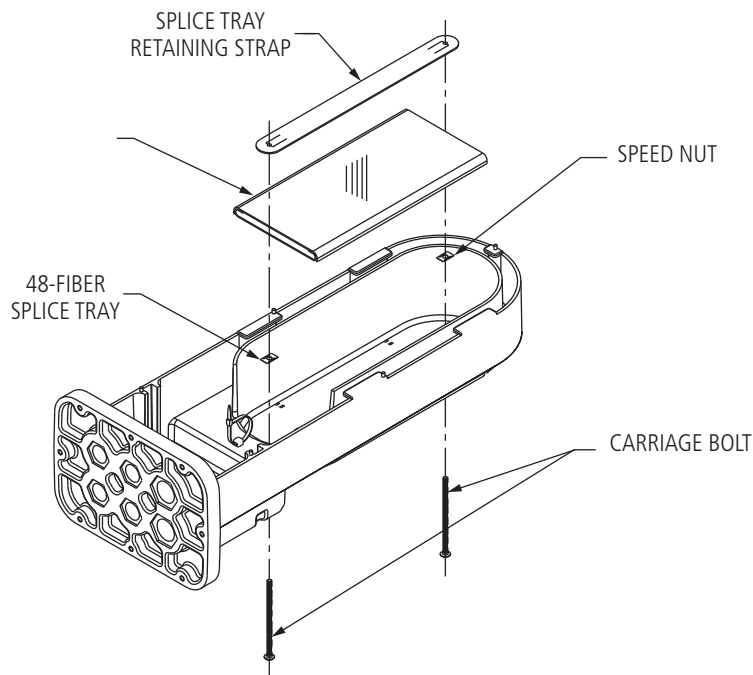

- B.5** The drawer assembly is now complete and ready to install into the casing. Torque the bolts to 35 in-lbs. This will cause a visual protrusion of the gasket approximately 1/64" to 1/32" from its original position. A pressure valve has been provided to pressurize the seal to 10 psi maximum.

**IMPORTANT:** Attach a guide clamp (sold separately) to each pair of cables approx. 12 inch (304 mm) from the bottom of the connector assembly before transporting the prepared enclosure. This will help prevent the cables from twisting inside the enclosure while transporting.



[www.AFLglobal.com](http://www.AFLglobal.com)