


THIS DRAWING AND ALL INFORMATION ON IT IS THE PROPERTY OF AFL. IT IS CONFIDENTIAL AND IT IS GIVEN TO YOU FOR A LIMITED PURPOSE AND MUST BE RETURNED UPON REQUEST. NEITHER THIS DRAWING OR ANY PART OF IT NOR ANY INFORMATION CONCERNING IT MAY BE COPIED, EXHIBITED, OR FURNISHED TO OTHERS NOR PHOTOGRAPHS TAKEN OF ANY ARTICLE FABRICATED OR ASSEMBLED FROM THE DRAWING WITHOUT THE CONSENT OF AFL.

ITEM NO:

DWG. NO:

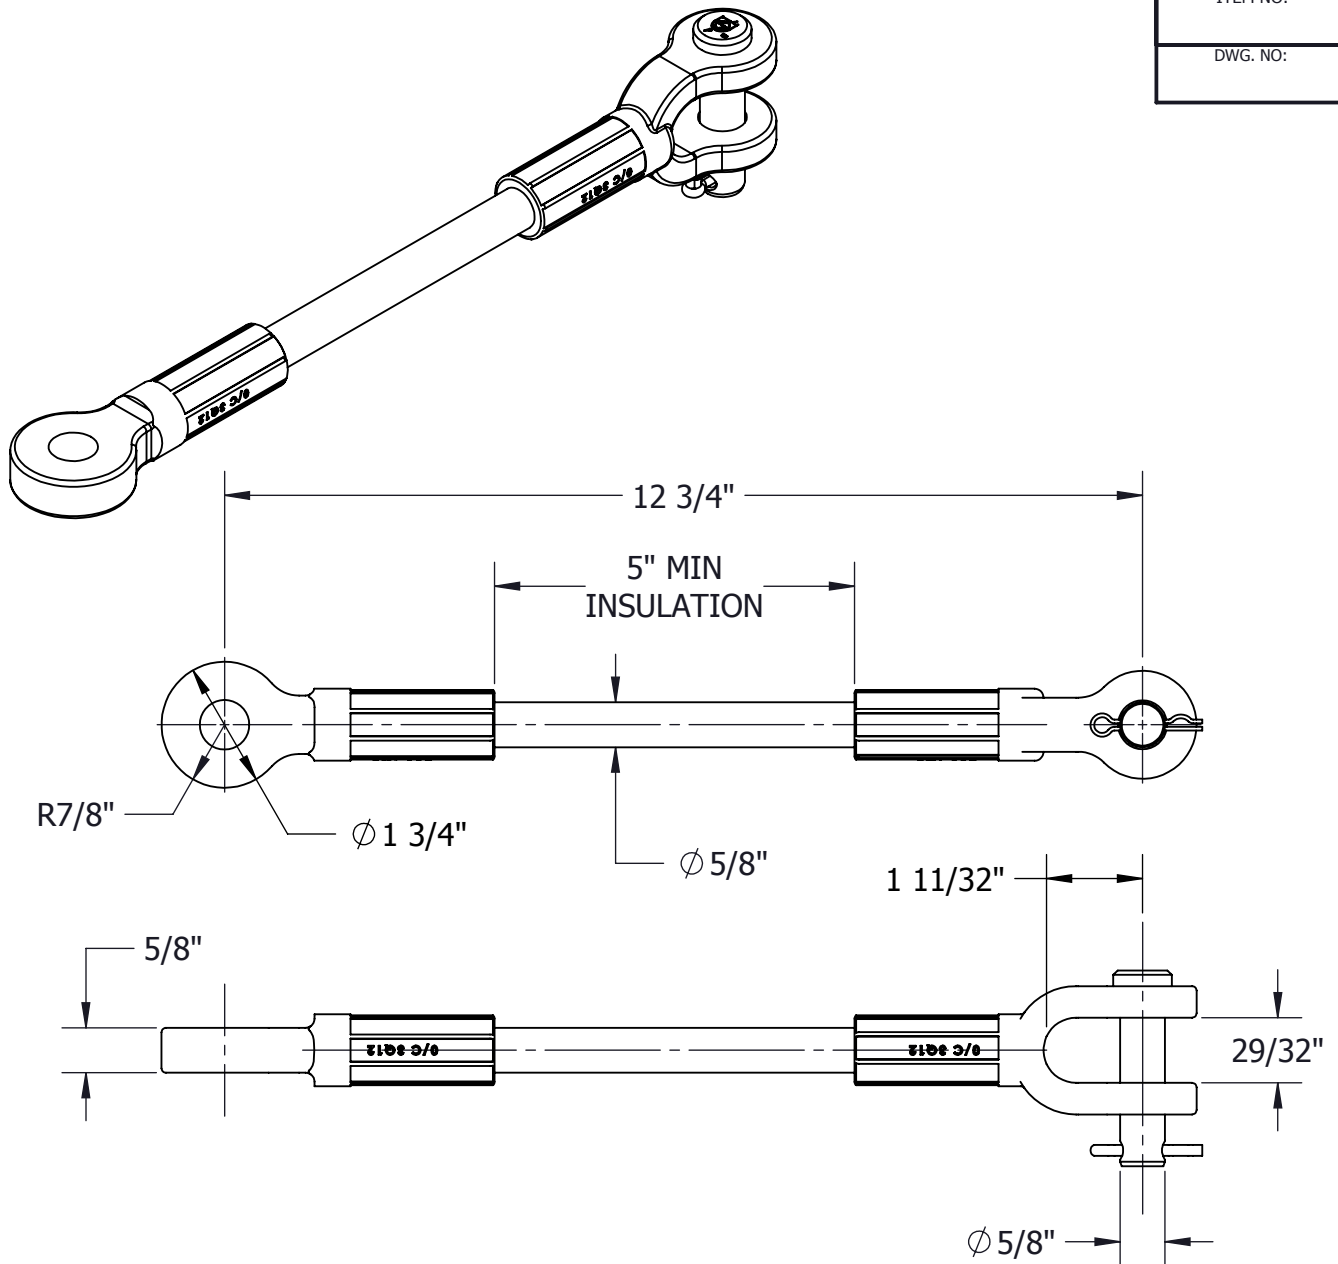

MATERIAL

*INSULATOR ENDS - DUCTILE IRON, H.D.G
INSULATOR ROD - 3/4" EPOXY - FIBERGLASS
*CLEVIS PIN - STEEL, H.D.G.
COTTER PIN - STAINLESS STEEL

ELECTRICAL RATING

LEAKAGE DISTANCE: 5 kV
DRY FLASHOVER: 60 kV
WET FLASHOVER: 31kV
OPERATING VOLTAGE: 750 VDC

MECHANICAL RATING

ULTIMATE LOAD: 16,000 LBS

WT: 2.0 LB

* = HOT DIP GALVANIZED

LOCATION

CONTRACT NO

CUST / CONTR

REV

DRN BY:
HV

DRN DATE:
11.8.12

CHK BY:
JL

CHK DATE:
11.8.12

PA 2012-1815.0

AFL

DOSSERT®

INSULATOR, 5/8" C/E

REV 1 PART NO:

INS63H-CE-STD

1 OF 1