


ITEM NO

DWG NO

D-6370

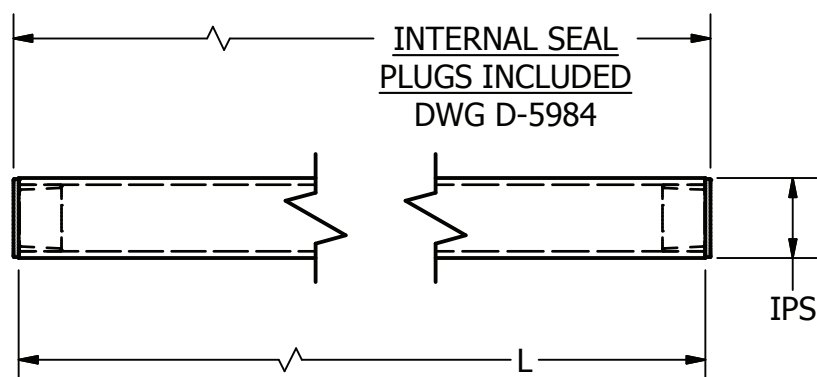

CAT.No	PIPE CAT.No	IPS	SCH	L=LENGTH
SSA125-L	SP125-L	1-1/4	40	AS REQUIRED
SSA125E-L	SP125E-L	1-1/4	80	AS REQUIRED
SSA150-L	SP150-L	1-1/2	40	AS REQUIRED
SSA150E-L	SP150E-L	1-1/2	80	AS REQUIRED
SSA200-L	SP200-L	2	40	AS REQUIRED
SSA200E-L	SP200E-L	2	80	AS REQUIRED
SSA250-L	SP250-L	2-1/2	40	AS REQUIRED
SSA250E-L	SP250E-L	2-1/2	80	AS REQUIRED

NOTE:

TRIMMED ENDS OF TUBING WILL BE
COATED WITH THE COLD GALVANIZED
COMPOUND Z.R.C. (95% ZINC)

MATERIAL:

STEEL PIPE ASTM A53 OR
A106 GRADE B

FINISH

GALVANIZED TO ASTM A123
OR ASTM A153

LOCATION

CONTRACT NO

CUST / CONTR

REVISIONS

REV	DESCRIPTION	DATE	BY	APR
3	ER-DRAWN IN INVENTOR	12-30-09	LK	EP

DRN BY:
JD
DRN DATE:
12/02/1985
CHK BY:

CHK DATE:

AFL**DOSSERT®**

PIPE, STRUT ASSEMBLY

REV
3

SP-L, SSA-L SERIES

1 OF 1

THIS DRAWING AND ALL INFORMATION ON IT IS THE PROPERTY OF AFL. IT IS CONFIDENTIAL AND IT IS GIVEN TO YOU FOR A LIMITED PURPOSE AND MUST BE RETURNED UPON REQUEST. NEITHER THIS DRAWING OR ANY PART OF IT NOR ANY INFORMATION CONCERNING IT MAY BE COPIED, EXHIBITED, OR FURNISHED TO OTHERS NOR PHOTOGRAPHS TAKEN OF ANY ARTICLE FABRICATED OR ASSEMBLED FROM THE DRAWING WITHOUT THE CONSENT OF AFL.