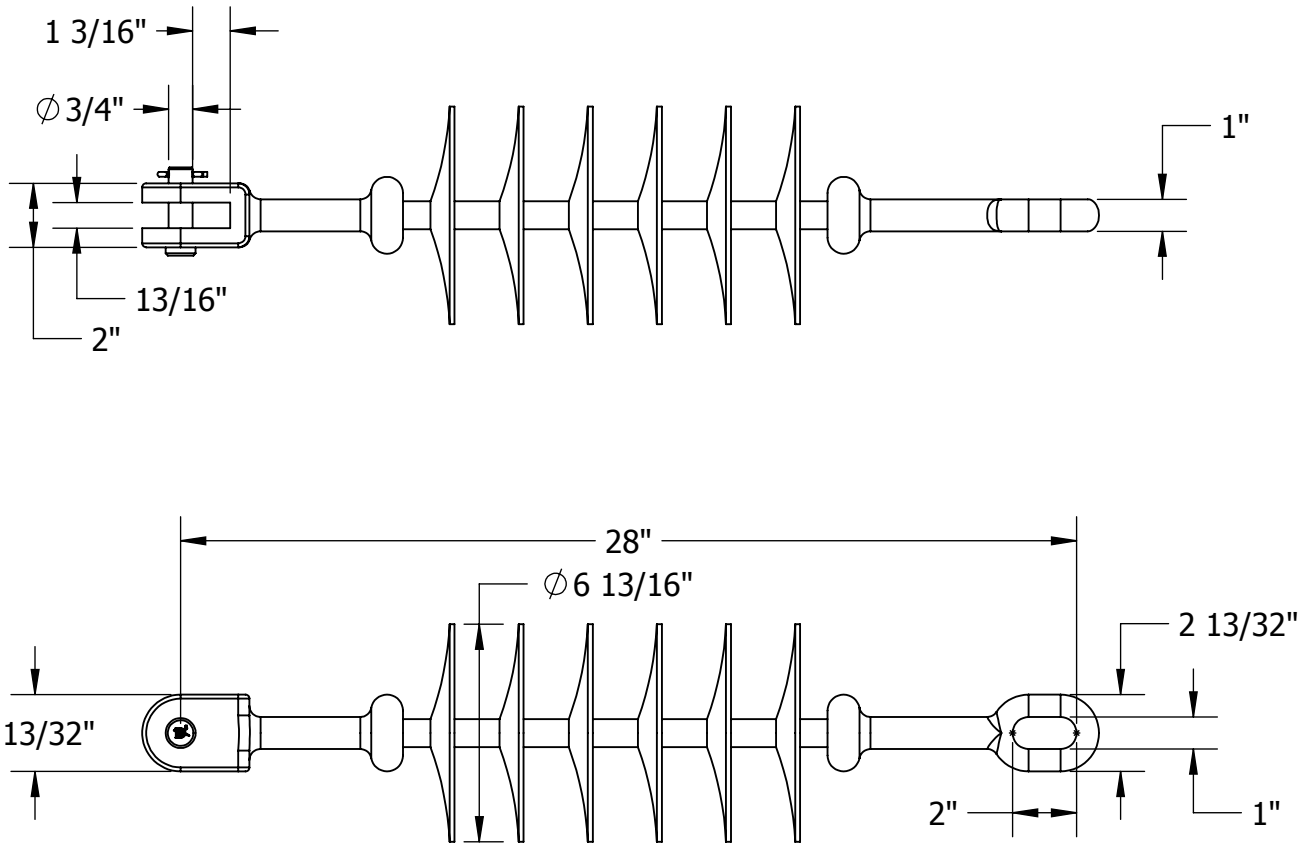


ITEM NO:

DWG. NO:

**MATERIAL:**

CLEVIS & EYE END - STEEL, H.D.G*

SKIRTS - SILICON RUBBER

INSULATOR ROD - FIBERGLASS

COTTER PIN - STAINLESS STEEL

MECHANICAL RATINGS:

MIN. ULTIMATE STRENGTH: 36,000 LBS

ROUTINE TEST LOAD (RTL): 18,000 LBS

ELECTRICAL RATINGS:

60 HZ DRY F.O. (MIN. WITHSTAND): 169kV (157kV)

60 HZ WET F.O. (MIN. WITHSTAND): 149kV (130kV)

CIFO + (MIN. WITHSTAND): 291kV (254kV)

CIFO - (MIN. WITHSTAND): 316kV (292kV)

WT: 4.00LBS

* = HOT DIP GALVANIZED

LOCATION

CONTRACT NO

CUST / CONTR

REVISIONS

REV	DESCRIPTION	DATE	BY	APR

DRN BY:
HVDRN DATE:
1.12.15CHK BY:
MCCHK DATE:
1.12.15

PA 2015.231.0

INSULATOR, STRAIN, CLEVIS/EYE, 28" LONG,
6" SHEDS, 25kV INLINE, 36KREV
0

PART NO:

DLI4A2-01

1 OF 1

THIS DRAWING AND ALL INFORMATION ON IT IS THE PROPERTY OF AFL. IT IS CONFIDENTIAL AND IT IS GIVEN TO YOU FOR A LIMITED PURPOSE AND MUST BE RETURNED UPON REQUEST. NEITHER THIS DRAWING OR ANY PART OF IT NOR ANY INFORMATION CONCERNING IT MAY BE COPIED, EXHIBITED, OR FURNISHED TO OTHERS NOR PHOTOGRAPHS TAKEN OF ANY ARTICLE FABRICATED OR ASSEMBLED FROM THE DRAWING WITHOUT THE CONSENT OF AFL.